


GENERAL NOTES

GENERAL PLAN NOTES:


- MH: AS NOTED
- POINTS CALCULATED AT: GRADE
- LIGHT LOSS FACTOR: AS NOTED
- CONTACT JANINE BURKHART FOR PRICING/QUOTATION INFORMATION

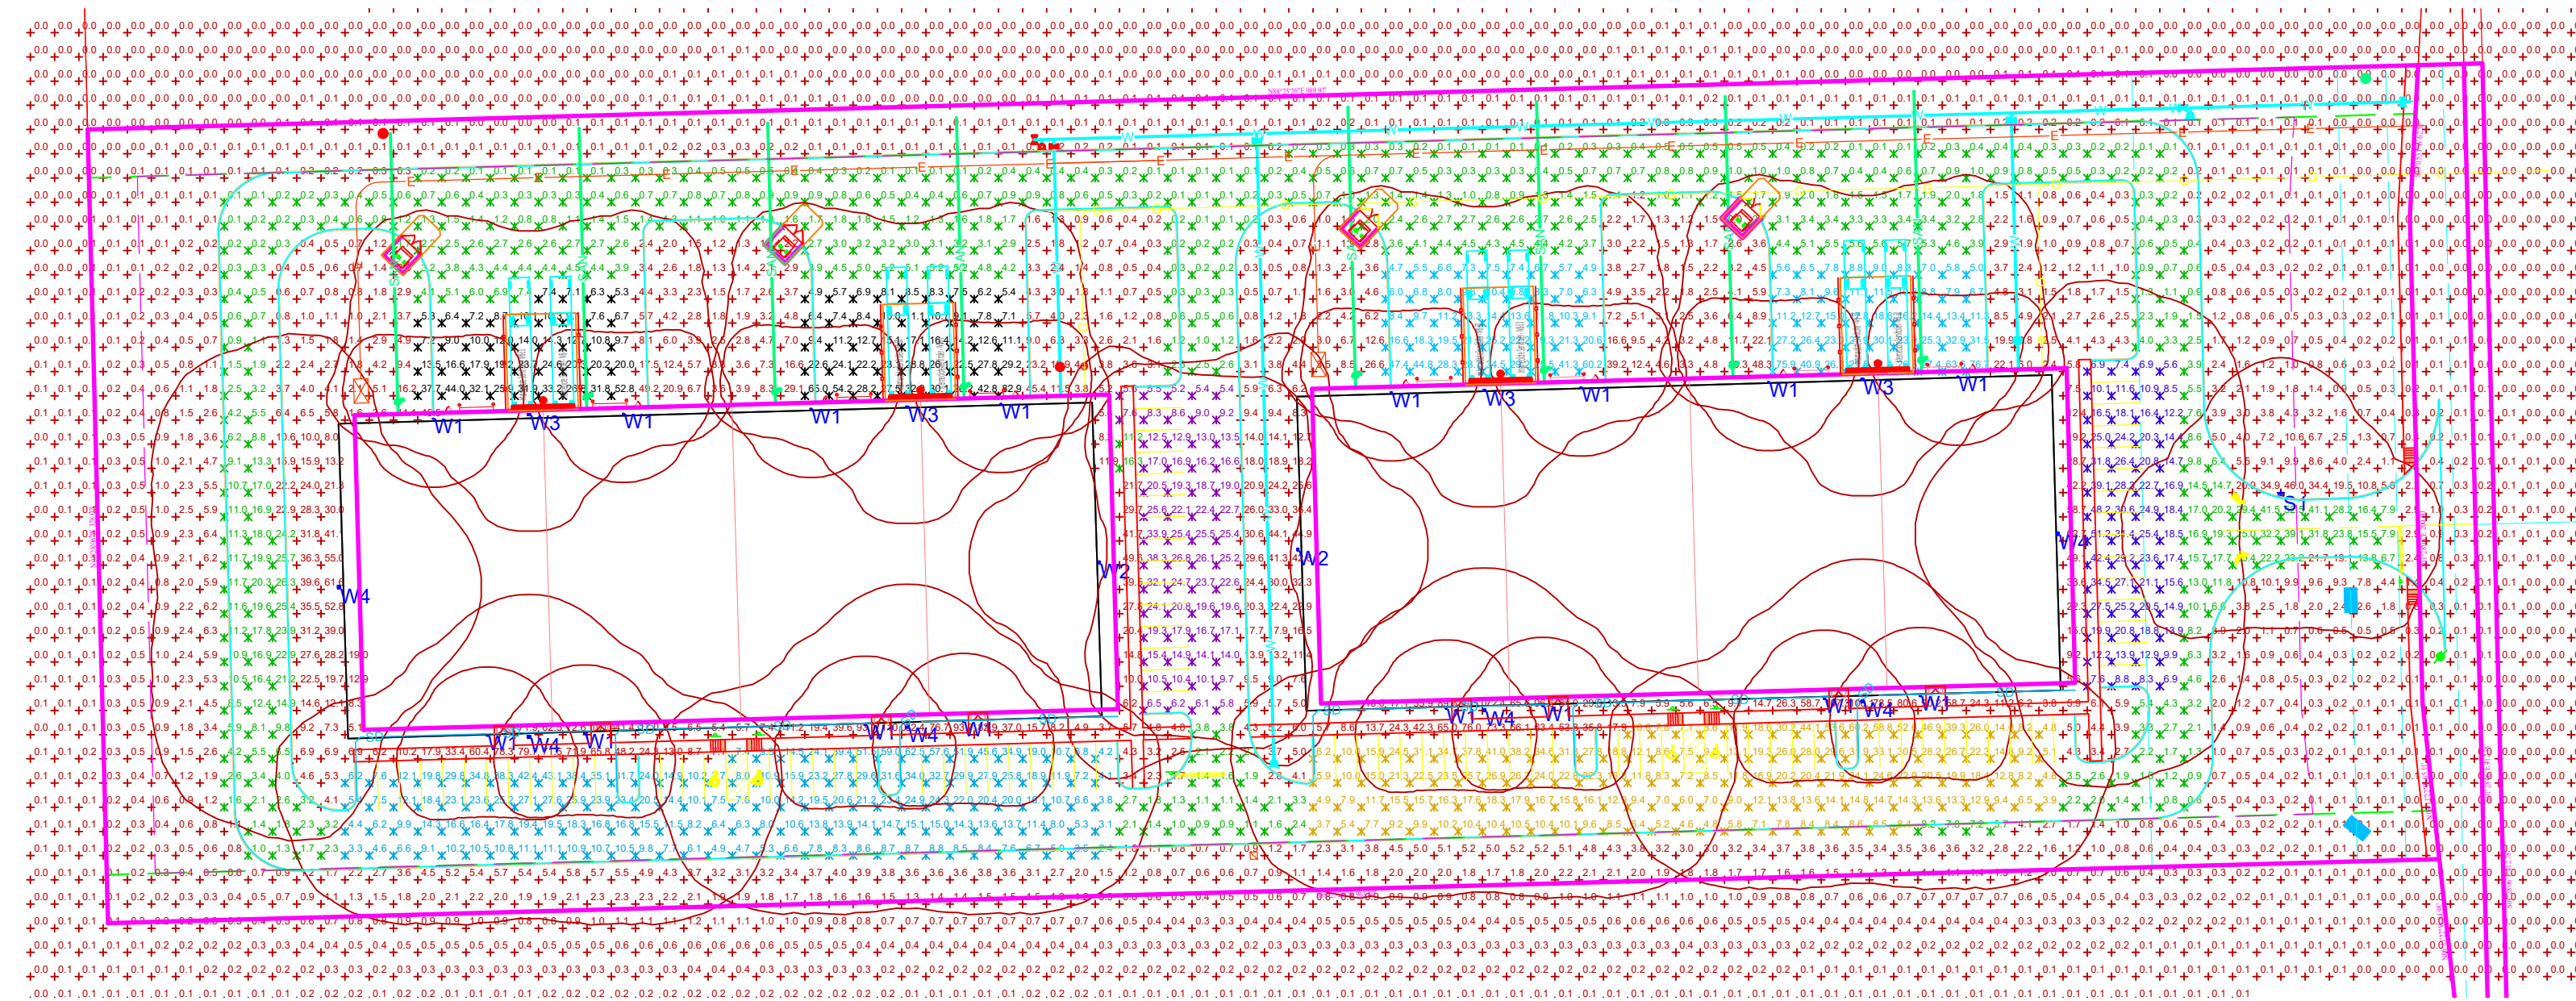

LIGHTING PHOTOMETRIC  
SCALE : 1/64" = 1FT

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
East Car Parking_Grade	✕	19.9 lux	51.2 lux	5.6 lux	9.1:1	3.6:1
Northeast Docks_50R Out_Grade	✕	18.6 lux	75.7 lux	4.7 lux	16.3:1	4.0:1
Northeast Docks_50R Out_Grade	✕	18.4 lux	82.9 lux	4.9 lux	16.9:1	3.8:1
Paved Areas_Grade	✕	11.3 lux	82.9 lux	0.1 lux	829.0:1	113.0:1
Site_Grade	+	5.4 lux	110.0 lux	0.0 lux	N/A	N/A
Southeast Car Parking_Grade	✕	17.2 lux	60.2 lux	3.7 lux	16.3:1	4.6:1
Southwest Car Parking_Grade	✕	17.0 lux	62.5 lux	2.4 lux	26.0:1	7.1:1
West Car Parking_Grade	✕	16.7 lux	38.3 lux	5.2 lux	7.4:1	3.2:1

Symbol	Label	Image	QTY	Manufacturer	Catalog Number	Description	Mounting	Lumens per Lamp	LLF	Footage
S1			1	Lithonia Lighting	RSX1 LED P3 40K R35 MVOLT SPA XXXXX / 05S 17' 0" DM94S XXXXX	RSX Area Luminaire Size 1 P3 Lumens Package 4000K CCT Type R35 Distribution	SINGLE POLE ASSEMBLY - 20' 0" H.O.D.M 17' 0" POLE WITH 2" 0" BASE	10109	0.95	72,9487
W1			16	Lithonia Lighting	WPX1 LED P2 40K Watt	WPX1 LED wallpack 1000m+ 4000K color temperature 120/277 Volt	WALL MOUNT - 10' 0" AFO	2913	0.95	24.42
W2			2	Lithonia Lighting	RSX1 LED P3 40K R4 MVOLT WBA XXXXX	RSX Area Fixture Size 1 P3 Lumens Package 4000K CCT Type R4 Distribution	WALL MOUNT - 25' 0" AFO	14206	0.95	109.44
W3			4	Lithonia Lighting	RSX1 LED P3 40K R4 MVOLT WBA XXXXX	RSX Area Fixture Size 1 P3 Lumens Package 4000K CCT Type R4 Distribution	WALL MOUNT - 25' 0" AFO	9972	0.95	72.95
W4			6	Lithonia Lighting	RSX1 LED P3 40K R3 MVOLT WBA XXXXX	RSX Area Fixture Size 2 P3 Lumens Package 4000K CCT Type R3 Distribution	WALL MOUNT - 25' 0" AFO	21736	0.95	149.98

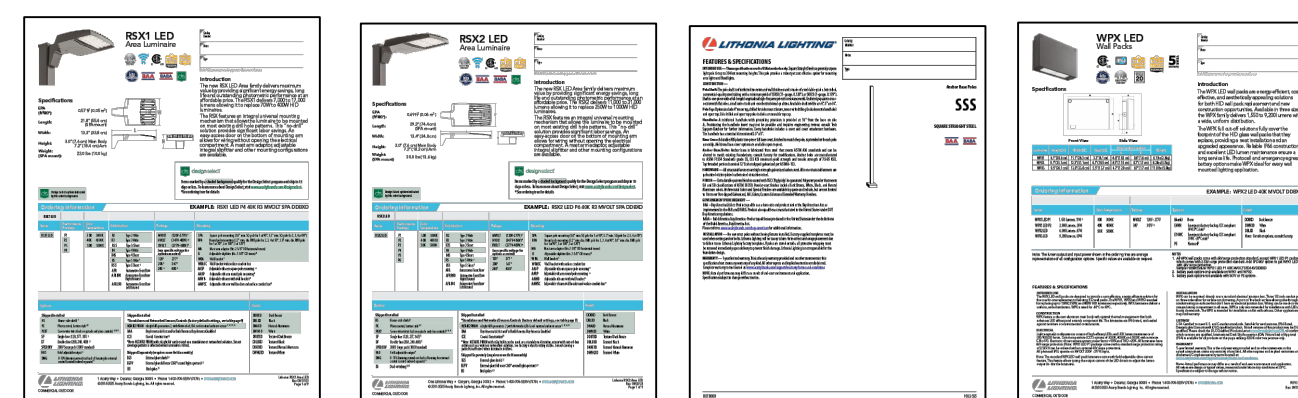

No.	Revision/Issue	Date

Firm Name and Address

**LIGHTSOURCE**  
THE LIGHTING & CONTROL EXPERTS

8719 CASTLE PARK DRIVE  
INDIANAPOLIS, IN 46256  
WWW.LIGHTSOURCEINDIANA.COM  
p.317-598-6900

Project Name and Address

**COMPASS & KEY INDUSTRIAL PARK**

EXTERIOR LIGHTING PHOTOMETRIC

Drawn By  
**ARH**

Scale  
**As Noted**

Date  
**2/12/2026**

Drawing #  
**LS-26-2116 SITE**

Sheet No.  
**E101**

Disclaimer  
This lighting submital is strictly based on the information provided by LIGHTSOURCE, and is provided without warranty as to accuracy, completeness, reliability or otherwise. If the information (including but not limited to floor plans, reflected ceiling plans, electrical plans and specifications) provided by ANY OTHER PARTY is incomplete or not current (i.e., recent revisions exist), the accuracy of proposed design may be adversely affected. Once this lighting submital is received by the customer or end-user (as applicable) it is the obligation of the customer and/or end-user to consult with a professional engineering advisor to determine whether the proposed design meets the applicable project requirements for lighting system performance, code compliance, safety, suitability and effectiveness for use in a particular application. In no event will LIGHTSOURCE be responsible for any loss resulting from any use of any information contained in this lighting submital.